




## STEAM TURBINE CALCULATION SHEET STEAM CONSUMPTION

No.	Designation		Quantity		Note and additional information	
1			<b>ADMISSION TURBINE</b>			
2	Turbine type		<b>CURTIS+REACTION</b>			
3			<b>Control stage : Curtis</b>			
4			<b>CONDENSING TURBINE</b>			
5	<b><u>REQUIRED CONDITION</u></b>					
6			<b>Normal</b>	<b>Rated</b>		
7	Steam flow available, m	ton/hr	15			
8	N	RPM	7000			
9	p <sub>i</sub>	bar A	100			
10	t <sub>i</sub>	C	550			
11	Admitted pressure	bar A	40			
12	Admitted steam mass flow, m <sub>a</sub>	ton/hr	5			
13	p <sub>o</sub>	bar A	0.12			
14	<b><u>STEAM DATA</u></b>					
17	h <sub>i</sub>	kJ/kg	3490			See steam Mollier diagram
18	h <sub>os</sub>	kJ/kg	2155			See steam Mollier diagram
19	Δh <sub>s</sub>	kJ/kg	1335			= h <sub>i</sub> - h <sub>os</sub>
20	Governor valve factor		0.97			Multi valve 0.97, single valve 0.93
21	Δh <sub>s</sub> '	kJ/kg	1295.0			= Gov. vlv. Factor x Δh <sub>s</sub> (equation 11)
22	h <sub>os</sub> '	kJ/kg	2195.1		See diagram	
23	p <sub>i</sub> '	bar A	80			
24	t <sub>i</sub> '	C	540			
25	v <sub>i</sub> '	m <sup>3</sup> /kg	0.0444		See steam table at p <sub>i</sub> ' and t <sub>i</sub> '	
26	<b><u>CALCULATION</u></b>					
27	<b><u>Control Stage</u></b>					
30	p <sub>o</sub> <sub>IMP</sub>	bar A	40			
31	h <sub>os</sub> ' <sub>IMP</sub>	kJ/kg	3265			
32	Head, Δh' <sub>IMP</sub>	kJ/kg	225			
33	Calc. diameter at best eff.	mm	506.75		Equation in fig. 9	
34	Selected dia., D	mm	500		Decide D, smaller than calculated	
35	Peripheral velocity, U	m/s	183.6		Equation 1	
36	Head coefficient, μ <sub>s</sub>		6.7			
37	h <sub>os</sub> ' <sub>IMP</sub>	kJ/kg	3265.0		= h <sub>i</sub> - Δh' <sub>IMP</sub>	
38	Efficiency, η <sub>05</sub>		0.71		Figure 12	
39	Entrance area factor, A		34			
40						
41	l x ε	mm	0.725		Equation 15 but replace P by (Δh <sub>s</sub> ' x m x η <sub>05</sub> )	
42	Nozzle height, l		25		Select l so that ε within the range below	
43	ε		0.029		0.015 - 0.45 for welded, min. 0.07 reaming	
44	Efficiency factor F <sub>l</sub>		0.93		Figure 13	
45	Efficiency factor F <sub>ε</sub>		0.799		Equation in figure 13	
46	Efficiency, η <sub>IMP</sub>		0.53		= η <sub>05</sub> x F <sub>l</sub> x F <sub>ε</sub>	




No.	Designation	Quantity		Note and additional information
1	$\Delta h_{eIMP}$	kJ/kg	118.4	$= \eta_1 \times \Delta h_{IMP}$
2	$h_{eIMP}$	kJ/kg	3371.6	
3	Exhaust temperature, to	C	470	See steam Mollier diagram
4	Exhaust specific volume, $v_o$	m <sup>3</sup> /kg	0.0825	See steam table
5	$P_{LOSS}$	kW	50.19	Equation 5
6	Control stage power, $P_{IMP}$	kW	443.3	$= (m \times \Delta h_{eIMP} / 3.6) - P_{LOSS}$
7	<u>Reaction Stages</u>			
8	Reaction stage steam flow, $m_R$	ton/hr	20.0	
9	$h_i$	kJ/kg	3371.6	
10	$h_{os'}$	kJ/kg	2235	
11	$\Delta h_{sR}$	kJ/kg	1136.55	
12	Pitch diameter, D	mm	720	See fig. 11, at required speed, select pitch and base diameter
13	Base diameter	mm	630	
14	Average blade height, l	mm	90	
15	D/l		8	
16	S/l		0.40	=0.2 LP blade, =0.4 MP and =0.6 HP
17	Calculated number of stages		17	Eq. 12a (integer number)
18	Peripheral velocity, U	m/s	264.3	
19	Steam velocity, C	m/s	365.5	
20	Velocity ratio, U/C		0.72	
21	$\Delta h_{sRSTG}$	kJ/kg	66.9	
22	$\eta_R$		0.85	
23	$\Delta h_{eR}$	kJ/kg	966.07	
24	$h_{eR}$	kJ/kg	2405.5	
25	X		0.940	
26	Wet enthalpy, $H_{wet}$	kJ/kg	2720.0	
27	Wet efficiency, $\eta_{WET}$		0.990	Equation 7.
28	Reaction stages efficiency, $\eta$		0.84	$= \eta_R \times \eta_{WET}$
29	Reaction stages power, $P_R$	kW	5314.6	$= m_R \times \Delta h_{sR} \times \eta$
30	Reaction + impulse power	kW	5757.971	$= P_R + P_{IMP}$
31	Mechanical efficiency, $\eta_m$		0.983	
32				
33	BHP	kW	5661.5	$= (P_R + P_{IMP}) \times \eta_m$
34				
35				
36				

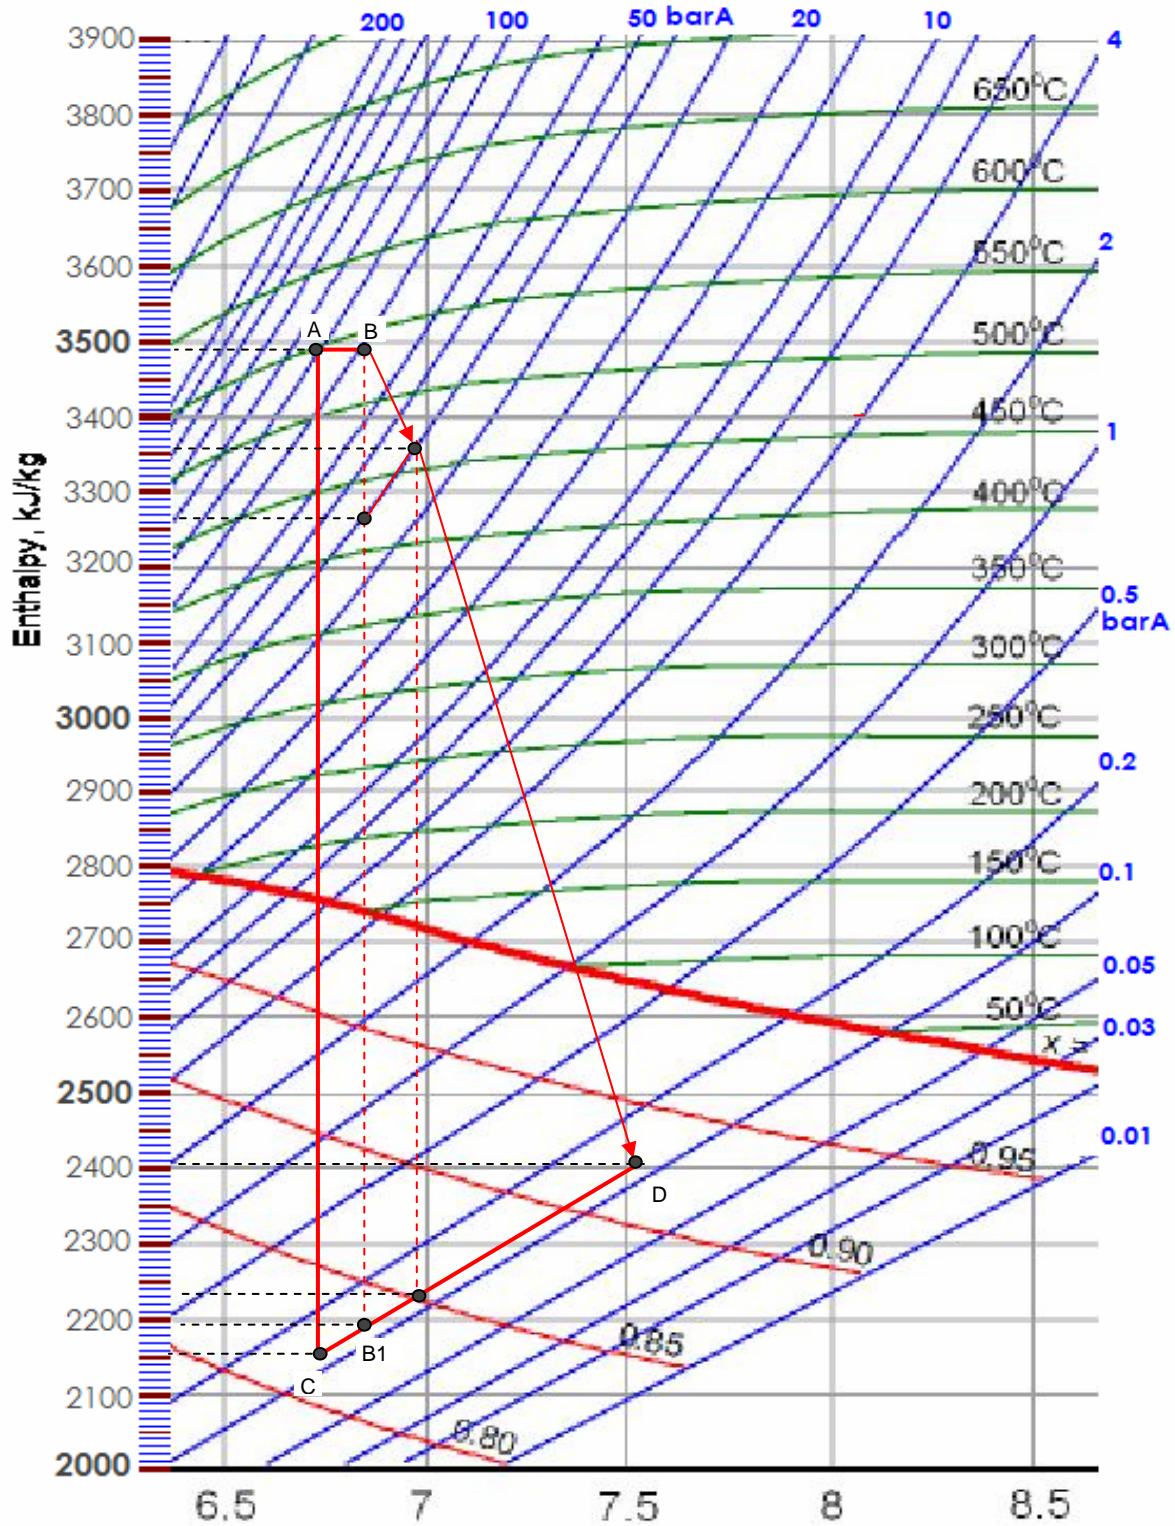



## STEAM TURBINE CALCULATION SHEET STEAM CONSUMPTION

No.	Designation	Quantity		Note and additional information
1		<b>ADMISSION TURBINE</b>		
2	Turbine type	<b>RATEAU+REACTION</b>		
3		<b>Control stage : Rateau</b>		
4		<b>CONDENSING TURBINE</b>		
5	<u>REQUIRED CONDITION</u>			
6		<b>Normal</b>	<b>Rated</b>	
7	Steam flow available, m	ton/hr	45	
8	N	RPM	6000	
9	pi	bar A	100	
10	ti	C	550	
11	Admitted pressure		40	
12	Admitted steam mass flow	ton/hr	10	
13	po	bar A	0.12	
14				
15	<u>STEAM DATA</u>			
16	hi	kJ/kg	3490	See steam Mollier diagram, point A.
17	hos	kJ/kg	2155	See steam Mollier diagram, point C
18	Δhs	kJ/kg	1335	= hi - hos
19	Governor valve factor		0.97	Multi valve 0.97, single valve 0.93
20	Δhs'	kJ/kg	1294.95	= Gov. vlv. Factor x Δhs (equation 11)
21	hos'	kJ/kg	2195.05	See diagram, point B1
22	pi'	bar A	80	
23	ti'	C	540	
24	vi'	m <sup>3</sup> /kg	0.0444	See steam table at pi' and ti'
25				
26	<u>CALCULATION</u>			
27	<u>Control Stage</u>			
28	po <sub>IMP</sub>	bar A	40	
29	hos' <sub>IMP</sub>	kJ/kg	3265	
30	Head, Δh' <sub>IMP</sub>	kJ/kg	225	
31	Selected dia., D	mm	700	Fig. 10, near cross point N and red dot line
32	Peripheral velocity, U	m/s	220.3	Equation 1
33	Number of stage, z		2	
34	Head coefficient, μ <sub>S</sub>		2.3	
35	Efficiency, η <sub>05</sub>		0.82	
36	Entrance area factor, A		34	
37				
38	l x ε	mm	0.577	Equation 15
39	Nozzle height, l		25	Select l so that ε within the range below
40	ε		0.023	0.015 - 0.45 for welded, min. 0.07 reaming
41	Efficiency factor F1		0.97	Figure 13
42	Efficiency factor Fe		0.891	Equation in figure 13
43	Efficiency, η <sub>IMP</sub>		0.706	= η <sub>05</sub> x F <sub>1</sub> x Fε
44	Δhe <sub>IMP</sub>	kJ/kg	158.8	= η <sub>IMP</sub> x Δh' <sub>IMP</sub>
45				

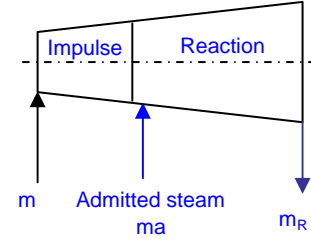



No.	Designation	Quantity		Note and additional information
1	$h_{eIMP}$	kJ/kg	3331.2	Than make steam process in Mollier diag.
2	Exhaust temperature, $t_o$	C	450	See steam Mollier diagram
3	Exhaust specific volume, $v_o$	$m^3/kg$	0.08	See steam table
4	$P_{LOSS}$	kW	130.59	Equation 5
5	Control stage power, $P_{IMP}$	kW	1854.9	$= (m \times \Delta h_{eIMP} / 3.6) - P_{LOSS}$
6	<b><u>Reaction Stages</u></b>			
7	Reaction stage steam flow, $m_R$	ton/hr	55.0	
8	$h_i$	kJ/kg	3331.2	
9	$h_{os'}$	kJ/kg	2220	
10	$\Delta h_{sR}$	kJ/kg	1111.16	
11	Pitch diameter, D	mm	750	See fig. 11, at required speed, select pitch and base diameter
12	Base diameter	mm	630	
13	Average blade height, I	mm	120	
14	D/I		6	
15	S/I		0.40	=0.2 LP blade, =0.4 MP and =0.6 HP
16	Calculated number of stages		21	Eq. 12a (integer number)
17	Peripheral velocity, U	m/s	236.0	
18	Steam velocity, C	m/s	325.2	
19	Velocity ratio, U/C		0.73	
20	$\Delta h_{sRSTG}$	kJ/kg	52.9	
21	$\eta_R$		0.880	
22	$\Delta h_{eR'}$	kJ/kg	977.82	
23	$h_{eR}$	kJ/kg	2353.3	
24	X		0.900	
25	Wet enthalpy	kJ/kg	2730	
26	Wet efficiency, $\eta_{WET}$		0.981	
27	Reaction stages efficiency, $\eta$		0.86	$= \eta_R \times \eta_{WET}$
28	Reaction stages power, $P_R$	kW	14651	$= m_R \times \Delta h_{sR} \times \eta$
29	Reaction + impulse power	kW	16506	$= P_R + P_{IMP}$
30	Mechanical efficiency, $\eta_m$		0.995	
31	BHP	kW	16424	$= (P_R + P_{IMP}) \times \eta_m$
32				
33				
34				

